


## ErP minimum efficiencies

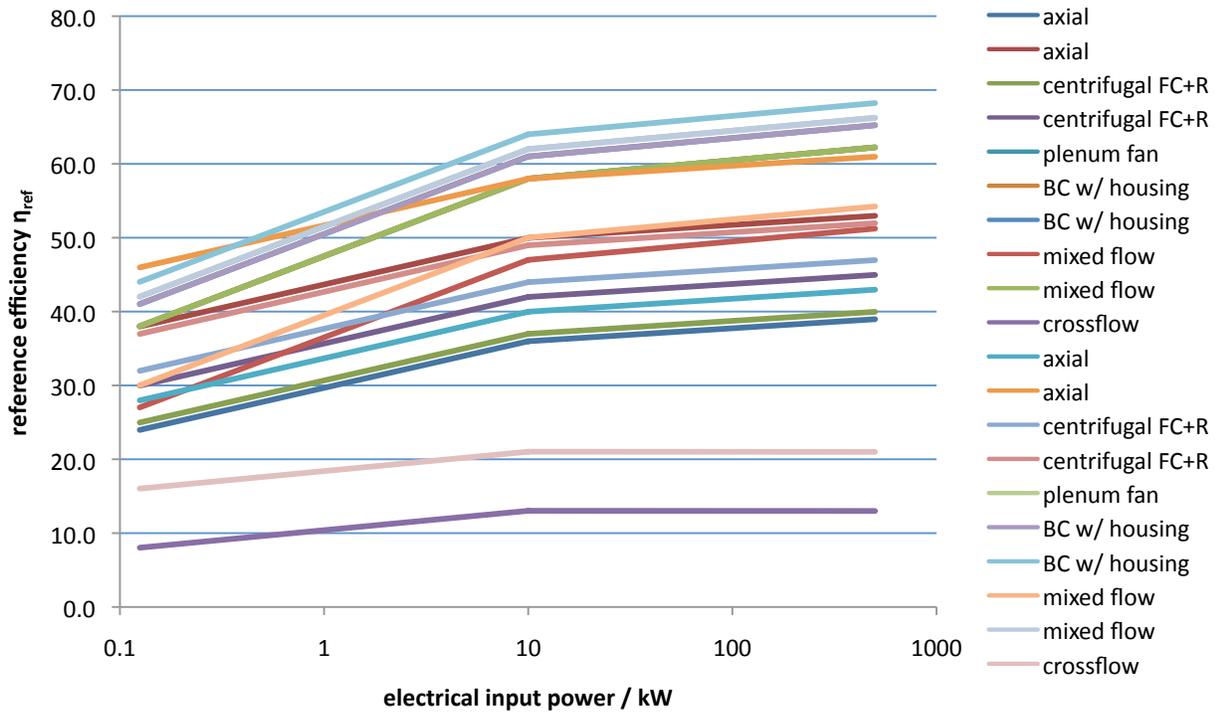

fan type	category	tier	kW		
			0.125	10	500
			target eff / %	target eff / %	target eff / %
axial	static	2013	24.0	36.0	39.0
axial	total	2013	38.0	50.0	53.0
centrifugal FC+R	static	2013	25.0	37.0	40.0
centrifugal FC+R	total	2013	30.0	42.0	45.0
plenum fan	static	2013	38.0	58.0	62.2
BC w/ housing	total	2013	38.0	58.0	62.2
BC w/ housing	static	2013	41.0	61.0	65.2
mixed flow	total	2013	27.0	47.0	51.2
mixed flow	static	2013	38.0	58.0	62.2
crossflow	total	2013	8.0	13.0	13.0
axial	static	2015	28.0	40.0	43.0
axial	total	2015	46.0	58.0	61.0
centrifugal FC+R	static	2015	32.0	44.0	47.0
centrifugal FC+R	total	2015	37.0	49.0	52.0
plenum fan	static	2015	42.0	62.0	66.2
BC w/ housing	total	2015	41.0	61.0	65.2
BC w/ housing	static	2015	44.0	64.0	68.2
mixed flow	total	2015	30.0	50.0	54.2
mixed flow	static	2015	42.0	62.0	66.2
crossflow	total	2015	16.0	21.0	21.0